Item # _____

Quantity _____

C.S.I. Section 11400

HOBART
701 S Ridge Avenue, Troy, OH 45374
1-888-4HOBART • www.hobartcorp.com

WPS-1260 WASTE PRO WASTE EQUIPMENT SYSTEM

STANDARD FEATURES

PULPER:

- **Pulper Tank:**
  30" diameter polished 300 series stainless steel tank weldment, 37" high
- **Pulping Disc:**
  13⅞" diameter stainless steel pulping disc
- **Rotating Shearing Cutters:**
  Investment cast 17-4 stainless steel
- **Particle Sizing Ring:**
  Fabricated stainless steel ring, matched to the pulping disc
- **Stationary Shearing Cutters:**
  Four carbide cutters mounted on sizing ring to provide shearing action
- **Legs:**
  Tubular stainless steel
  Adjustable ¾" in either direction
- **Water Consumption:**
  0-4 GPM with 25 psi line pressure
- **Time/Stop Cycle:**
  Sprays hot water on the screen to reduce clean-up time by 60%

ELECTRICAL:

- **Pulper Motor:**
  6.0 horsepower, TEFC (Totally Enclosed Fan Cooled)
  Direct drive with 1⅝" diameter shaft
- **Waterpress Motor:**
  2.0 horsepower, TEFC
- **Recirculating Pump Motor:**
  3.0 horsepower, TEFC
- **Controls:**
  Prewired wall mount electrical control panel
  NEMA 4 stainless steel enclosure
  Magnetic-type motor contactors
  Overload protection
  Nominal 115 volt and 24 volt control circuit wiring
  Junction box with terminal strips mounted on waterpress for easy access
  Remote “Start-Stop” push-button station
  Chemical pump standard
  Programmable Logic Controller

MODEL

❑ WPS-1260 Waste Equipment System

OPTIONS

❑ **FREE-STANDING MODELS:**
- ❑ **Feed Tray Assembly:**
  Stainless steel construction
  Ergonomically designed
  Removable splash curtain
  24" x 25" feed tray with standard flushing action
- ❑ **Hinged Cover:**
  Interlocked to prevent operation when opened

❑ **UNDERCOUNTER MODELS:**
- ❑ **Removable Cover Plate:**
  Integrated interlock switch
  Rubber boot included with cover plate

❑ **ALL MODELS:**
- ❑ Trough connection, 9" wide or 12" wide
- ❑ Flush mounted control panel
- ❑ 2nd remote Start/Stop button
- ❑ Flange-style seismic feet
- ❑ Trough magnet, bottom-trough or side-trough mount (1 pair)

Specifications, Details and Dimensions on Inside and Back.

c UL us LISTED

HOBART

WPS-1260 WASTE PRO WASTE EQUIPMENT SYSTEM

WPS-1260 WASTE PRO WASTE EQUIPMENT SYSTEM

HOBART
701 S Ridge Avenue, Troy, OH 45374
1-888-4HOBART • www.hobartcorp.com

MODEL: WPS1260 FS
OPERATION
E-974558
REV. B

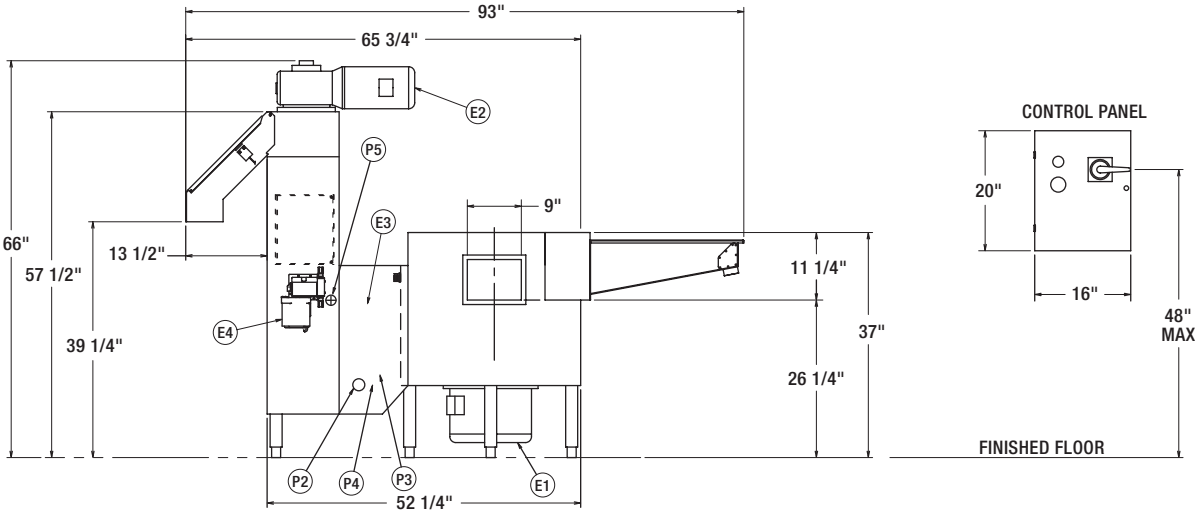

WPS-1260 ELEVATION VIEW

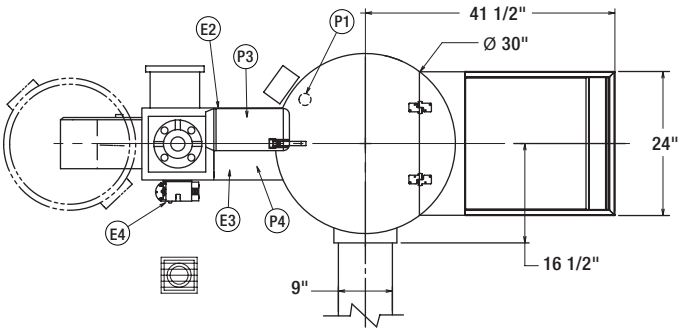

WPS-1260 PLAN VIEW



OPTIONAL FEED TRAY
VIEW A-A



WALL MOUNTED CONTROL BOX
(ELECTRICAL CONDUIT HOLES TO BE ADDED AT TIME OF INSTALLATION)
MOUNT BOX 48" AFF. MAX (AT HANDLE)
LOCATION TO BE DETERMINED BY INSTALLER & NEC/LOCAL CODES

WARNING

ELECTRICAL AND GROUNDING CONNECTIONS MUST COMPLY WITH THE APPLICABLE PORTIONS OF THE NATIONAL ELECTRICAL CODE AND/OR OTHER LOCAL ELECTRICAL CODES.

PLUMBING CONNECTIONS MUST COMPLY WITH APPLICABLE SANITARY, SAFETY AND PLUMBING CODES.

CONNECTION INFORMATION

(AFF - ABOVE FINISHED FLOOR)

E1 ELECTRICAL CONNECTION - PULPER DRIVE MOTOR

E2 ELECTRICAL CONNECTION - WATERPRESS DRIVE MOTOR

E3 ELECTRICAL CONNECTION - RETURN PUMP MOTOR

E4 ELECTRICAL CONNECTION - CHEMICAL ADDITIVE PUMP

E5 ELECTRICAL CONNECTION - SERVICE SUPPLY 1-3/4" CONDUIT HOLE

P1 DRAIN VALVE OUTLET CONNECTION (PIPE TO FLOOR SINK), 2" NPT (MALE), 4" AFF.

P2 RETURN WATER OUTLET CONNECTION, 1-1/2"FPT (MALE), 14" AFF.

P3 FRESH COLD WATER INLET CONNECTION, 1/2" FPT (FEMALE), 13" AFF.

P4 FRESH HOT WATER INLET CONNECTION, 1/2" FPT (FEMALE), 13" AFF.

P5 OVERFLOW OUTLET CONNECTION, 1-1/2" FPT (FEMALE), 27" AFF.

POWER SUPPLY	PULPER MOTOR	RETURN PUMP MOTOR	WATER PRESS MOTOR	RATED AMPS	MINIMUM SUPPLY CIRCUIT CONDUCTOR AMPACITY
208/60/3	6 HP	3 HP	2 HP	32.3	40
230/60/3	6 HP	3 HP	2 HP	29.6	35
460/60/3	6 HP	3 HP	2 HP	15.8	20

GENERAL NOTES

1. ALL DIMENSIONS TAKEN FROM FLOOR LINE MAY BE INCREASED OR DECREASED BY 3/4".
2. ELECTRICAL CONTROL PANEL, BY HOBART, SHOULD BE LOCATED WITHIN SIGHT OF PULPER AND BE EASILY ACCESSIBLE.
3. APPROXIMATE SHIPPING WEIGHT: 1175 LBS.

PLUMBING NOTES

1. CUSTOMER TO PROVIDE PIPING FROM FRESH WATER SUPPLY (HOT & COLD) TO PULPER AND FROM PULPER DRAIN LINE TO FLOOR SINK OR FLOOR DRAIN.

   RECOMMENDED BUILDING FLOWING WATER PRESSURE TO THE PULPER IS 30 PSIG MIN (18 GPM).

   IF FRESH WATER SUPPLY PRESSURE IS HIGHER THAN 45 PSIG, A PRESSURE REGULATING VALVE MUST BE INSTALLED IN THE WATER LINE (BY OTHERS).
2. TROUGH RETURN WATER PIPING TO BE TYPE L COPPER, SCHEDULE 40 GALVANIZED OR EQUIVALENT (PVC PIPING NOT ACCEPTABLE)
3. TERMINATE FRESH WATER LINE AND TROUGH CONNECTIONS WITH UNION OR FLANGE TYPE FITTING.
4. HOT AND COLD WATER HOSE BIBS (FOR DAILY CLEANING OF UNIT), TO BE INSTALLED CLEAR OF BUT ACCESSIBLE TO UNIT, WITH A HEAVY DUTY HOSE AND SQUEEZE VALVE. (SUPPLIED BY OTHERS).
5. FLOOR DRAIN OR FLOOR SINK (ACCORDING TO LOCAL CODE REQUIREMENTS), TO BE KEPT CLEAR OF, BUT ACCESSIBLE TO THE UNIT.
6. PROTECT ALL EQUIPMENT AND RELATED PIPING FROM FREEZING TEMPERATURES AND CONDENSATION.
7. PLUMBING MUST RUN UPHILL TO TROUGH CONNECTION.
8. NO EXTERNAL STRAIN TO BE EXERTED ON HOBART EQUIPMENT.

ELECTRICAL NOTES

1. ELECTRICAL CONTROL PANEL IS A SURFACE MOUNTED ENCLOSURE AVAILABLE IN NEMA 4 (SST), CLOSED COUPLED-(16"x20"x8"), REMOTE-(16"x20"x8"), WATERPRESS-(16"x20"x8").
2. EACH ELECTRICAL CONTROL PANEL IS PREWIRED FROM THE FACTORY AND CONTAINS THE FOLLOWING ITEMS:
   (A) MAIN CIRCUIT BREAKER (THERMAL MAGNETIC) INTERLOCKED WITH DOOR HANDLE.
   (B) MAGNETIC CONTROLLER WITH OVERCURRENT PROTECTION FOR EACH MOTOR.
   (C) STEP-DOWN TRANSFORMER FOR 115 VOLT (NOMINAL) CONTROL CIRCUIT OPERATION.
   (D) ALL CONTROLS DESIGNED TO MEET THE REQUIREMENTS OF UL-508
3. CONTROL CIRCUIT TO BE 115 VAC NOMINAL
4. ALL CONTROL PANELS ARE TO BE WIRED IN ACCORDANCE TO LOCAL, STATE AND/OR NATIONAL ELECTRIC CODE SPECIFICATIONS
5. REMOTE PUSHBUTTON STATION TO BE MOUNTED & WIRED AT WORKSTATION BY CUSTOMER. (BRACKET SUPPLIED BY CUSTOMER)
6. REMOTE PUSH BUTTON STATION HOUSES TWO (2) ILLUMINATED PUSH BUTTONS.
7. EQUIPMENT DRIVE MOTORS ARE PROVIDED AS FOLLOWS:
   (A) PULPER DRIVE MOTOR IS TOTALLY ENCLOSED, FAN COOLED.
   (B) RECIRCULATING PUMP MOTOR IS TOTALLY ENCLOSED, FAN COOLED.
   (C) WATERPRESS MOTOR IS TOTALLY ENCLOSED, FAN COOLED.
8. CUSTOMER TO PROVIDE ALL INTERCONNECTING WIRING FROM PREWIRED ELECTRICAL CONTROL PANEL TO PREWIRED TERMINAL BLOCKS, ELECTRICAL WIRING DIAGRAM PROVIDED WITH EACH PULPER.

HOBART
701 S Ridge Avenue, Troy, OH 45374
1-888-4HOBART • www.hobartcorp.com

WPS-1260 WASTE PRO WASTE EQUIPMENT SYSTEM

MODEL: WPS1260 UC
OPERATION
E-974559
REV. B

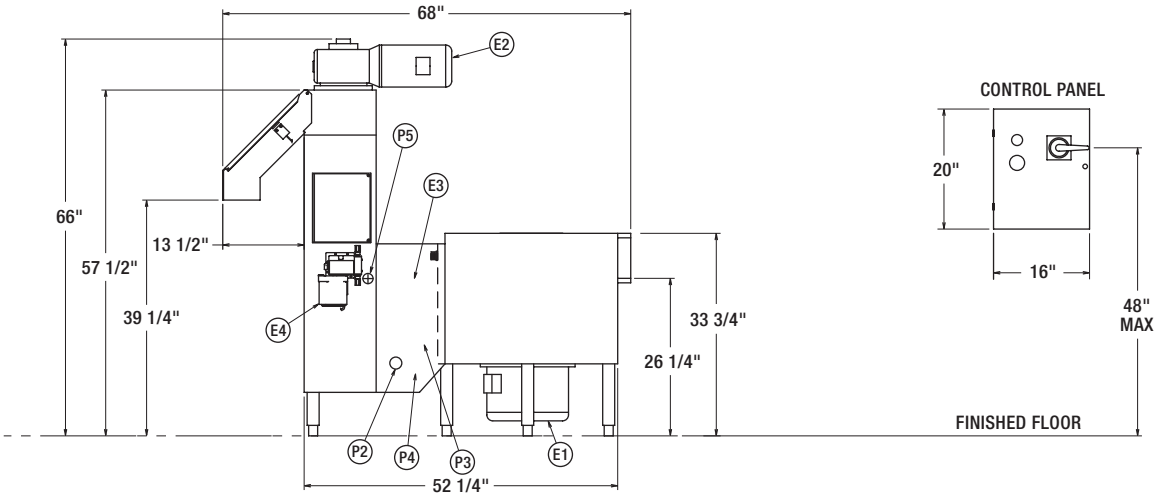

WPS-1260 ELEVATION VIEW (UNDER COUNTER)

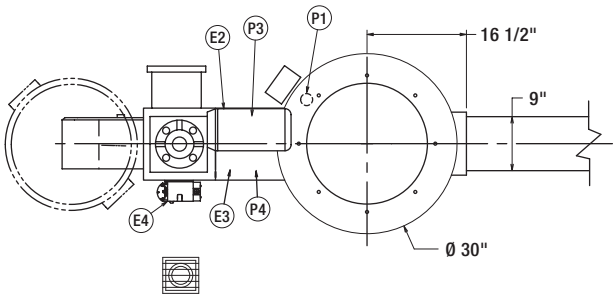

WPS-1260 PLAN VIEW (UNDER COUNTER)

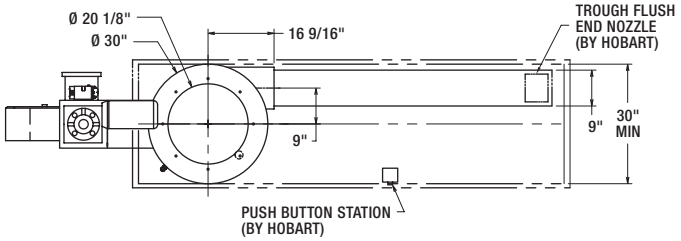

PLAN VIEW WPS-1260 UC PULPER
SHOWN WITH 9" TROUGH CONNECTION

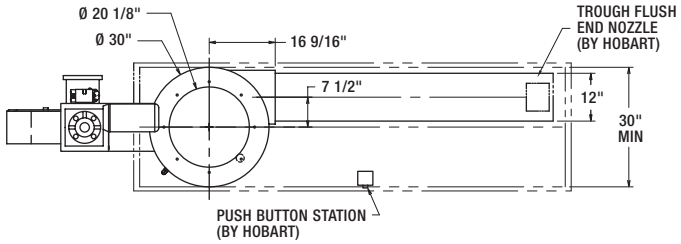

PLAN VIEW WPS-1260 UC PULPER
SHOWN WITH 12" TROUGH CONNECTION

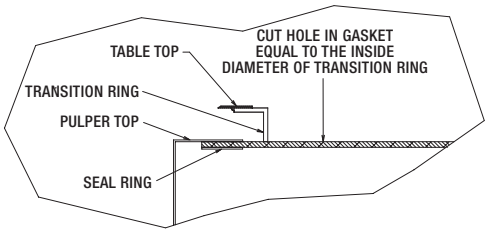

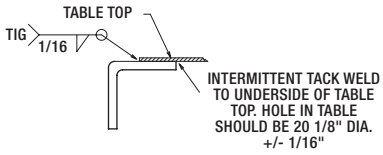

DETAIL "A" – TRANSITION RING
ATTACHMENT TO TABLE BY APPLICABLE CONTRACTOR

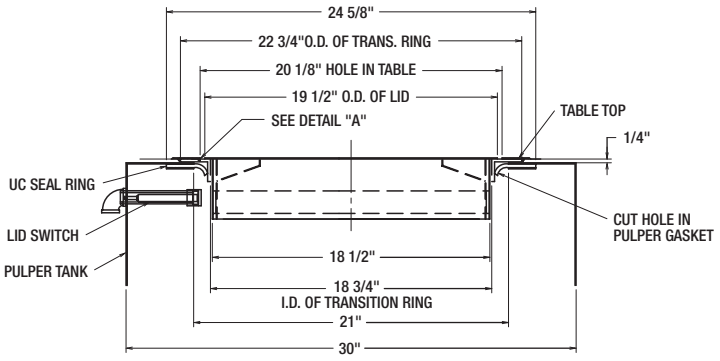



WALL MOUNTED CONTROL BOX
(ELECTRICAL CONDUIT HOLES TO BE ADDED AT TIME OF INSTALLATION)
MOUNT BOX 48" AFF. MAX (AT HANDLE)
LOCATION TO BE DETERMINED BY INSTALLER & NEC/LOCAL CODES

THE UC GASKET IS HELD TO THE UNDERSIDE OF THE PULPER TOP BY THE TWO HALVES OF THE TOP SEAL RING AND WELD STUDS. ELEVATE THE PULPER UNTIL THE GASKET IS IN CONTACT WITH THE BOTTOM EDGE OF THE UC TRANSITION RING. FROM THE INSIDE OF THE PULPER, CUT A HOLE IN THE GASKET USING THE TRANSITION RING AS A GUIDE (ROUGHLY 18 3/4 DIA.) ELEVATE THE PULPER THE REMAINDER OF THE WAY SINKING THE TRANSITION RING INTO THE HOLE IN THE GASKET.

UNDER COUNTER MOUNTING DETAIL

WPS-1260 WASTE PRO WASTE EQUIPMENT SYSTEM

HOBART
701 S Ridge Avenue, Troy, OH 45374
1-888-4HOBART • www.hobartcorp.com

Benefits of Waste Equipment

- Up to 88% reduction of waste volume.
- Savings on water usage.
- Reduced sewer costs.
- Labor Savings:
  - Reduction in man hours to haul waste to pick-up area.
  - Eliminates the need to sort paper from food waste.
  - Dishwashing labor reduced by speeding up the scrapping operation.
- Reduction in solids discharged to sewer lines as compared to a food waste disposer.

* Based on foodservice waste mix of 41% food soil, 32% free liquid, 10% paper, 11% cardboard, 2.2% polystyrene, 1% film, 1% miscellaneous, 1% polypropylene (e.g. straws). Always consult your local Hobart representative to review and verify the content of your waste mix.

TABLE TROUGH CONNECTION FLANGES

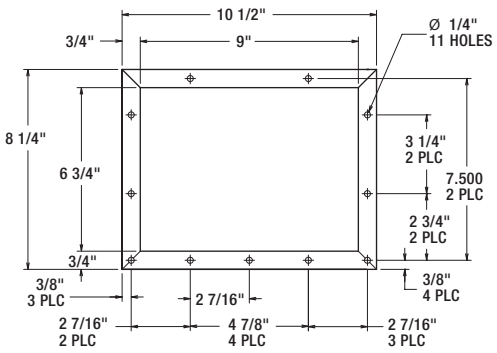

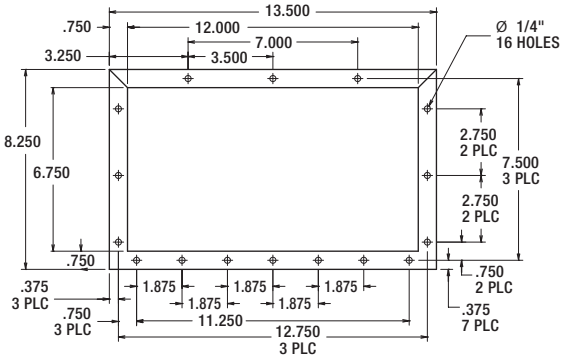

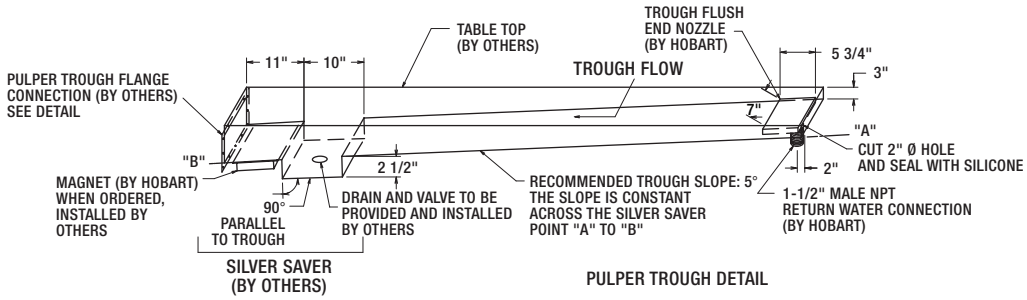

PULPER TROUGH DETAIL

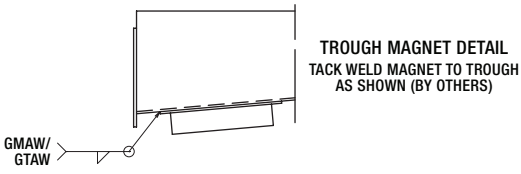

TROUGH MAGNET DETAIL
TACK WELD MAGNET TO TROUGH
AS SHOWN (BY OTHERS)

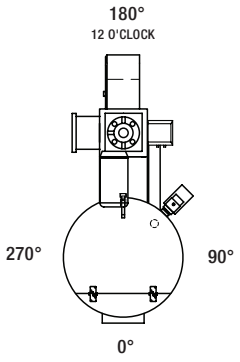

SPECIFIC LAYOUT TO BE DETERMINED BY FACTORY

As continued product improvement is a policy of Hobart, specifications are subject to change without notice.